

Report No.:

Test Time: 2018-07-09 10:09

## Luminaire Property

Luminaire Manufacturer:  
Luminaire Description: A65  
Current: 0.119 A  
Power Factor: 0.528

Voltage: 230.4 V  
Power: 14.47 W


## Photometric Results

CIE Class: Direct  
Measurement Flux: 1244.7 lm  
Downward Ratio: 100%  
Horizontal Diffuse Angle(100%): H2  
Vertical Diffuse Angle(100%): V1  
Luminaire Efficacy Rating (LER): 86.07  
Max. Intensity: 272.34 cd  
S/MH(C0/C180): 1.43


Total Rated Lamp Lumens: 1244.7 lm  
Efficiency: 100%  
Upward Ratio: 0%

Central Intensity: 272.29 cd  
Pos of Max. Intensity: H0 V1  
S/MH(C90/C270): 1.42

Picture Of Luminaire



Luminous Intensity Distribution Curve


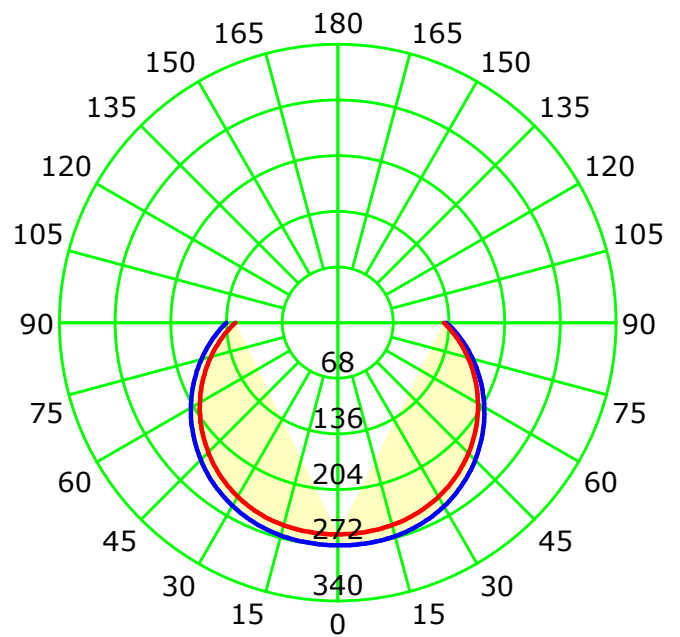


— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 22.5  
Test Lab:  
Test Type: TYPE C  
Temperature: 常温  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: GPM-1600L  
Distance: 7.206 m  
Humidity: 相对湿度65  
Inspector:

## Luminous Intensity Distribution Curve

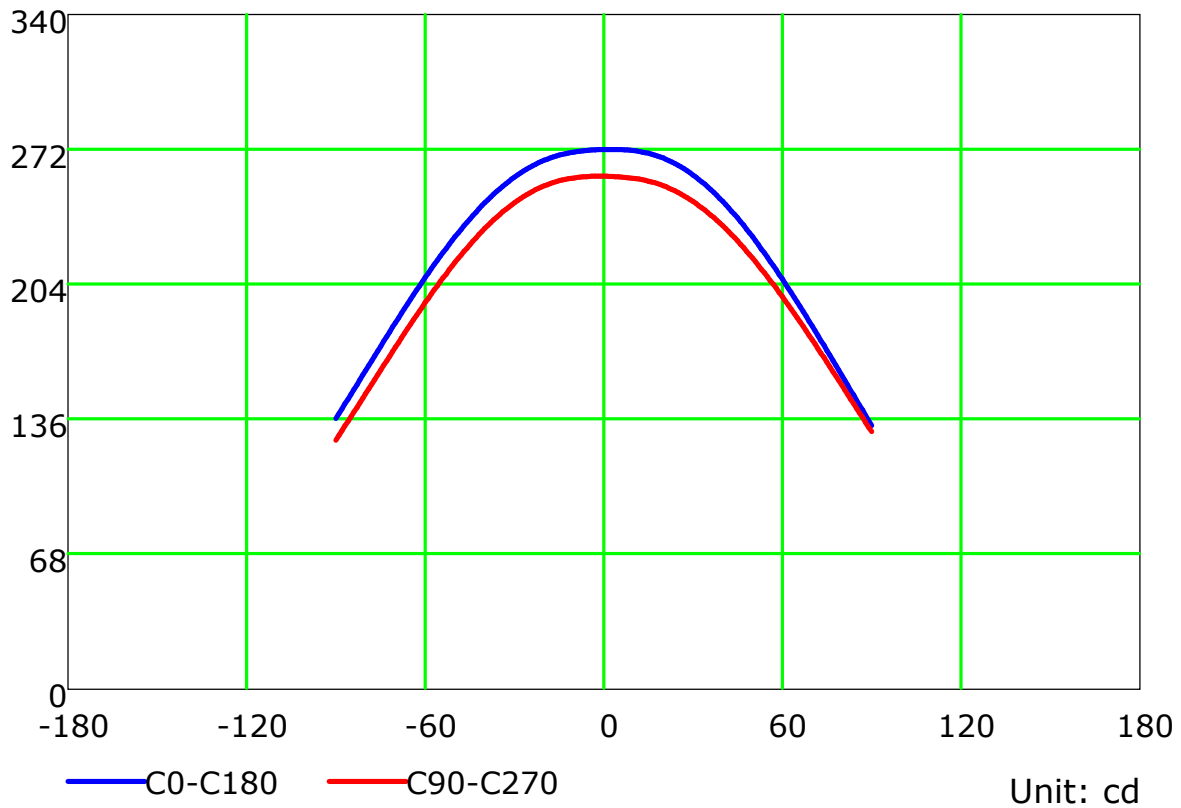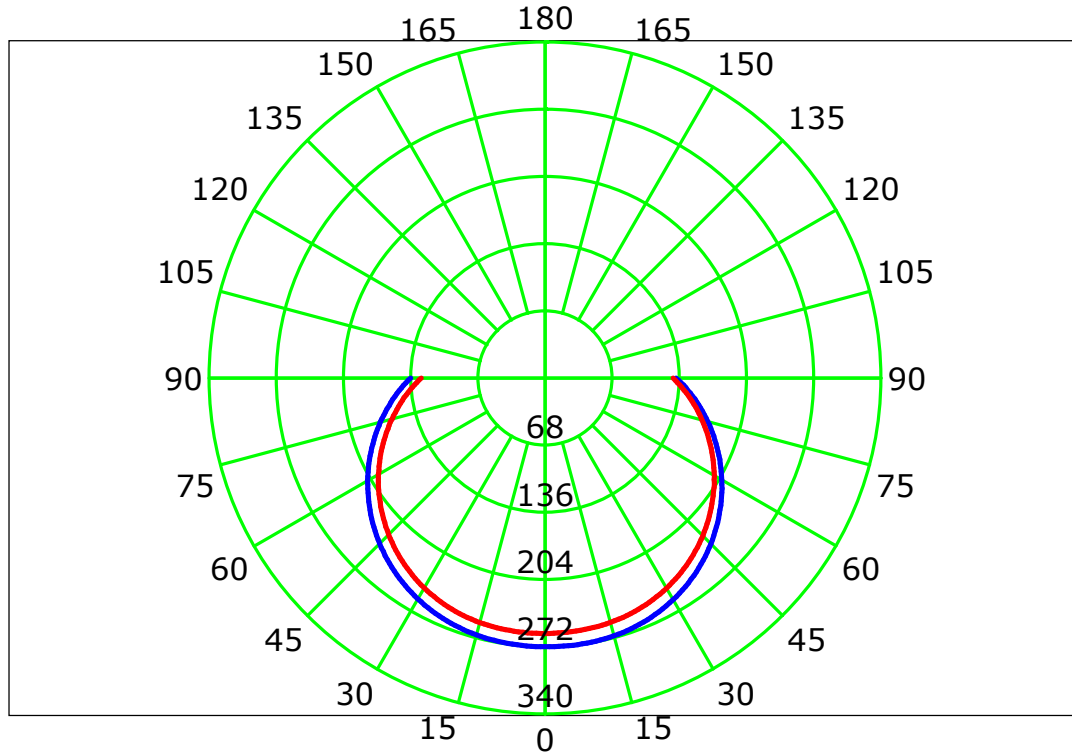


C Plane (°):0.0-360.0: 22.5  
Test Lab:  
Test Type: TYPE C  
Temperature: 常温  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: GPM-1600L  
Distance: 7.206 m  
Humidity: 相对湿度65  
Inspector:

Unit: cd

## Luminous Intensity Distribution Curve(cd/klm)

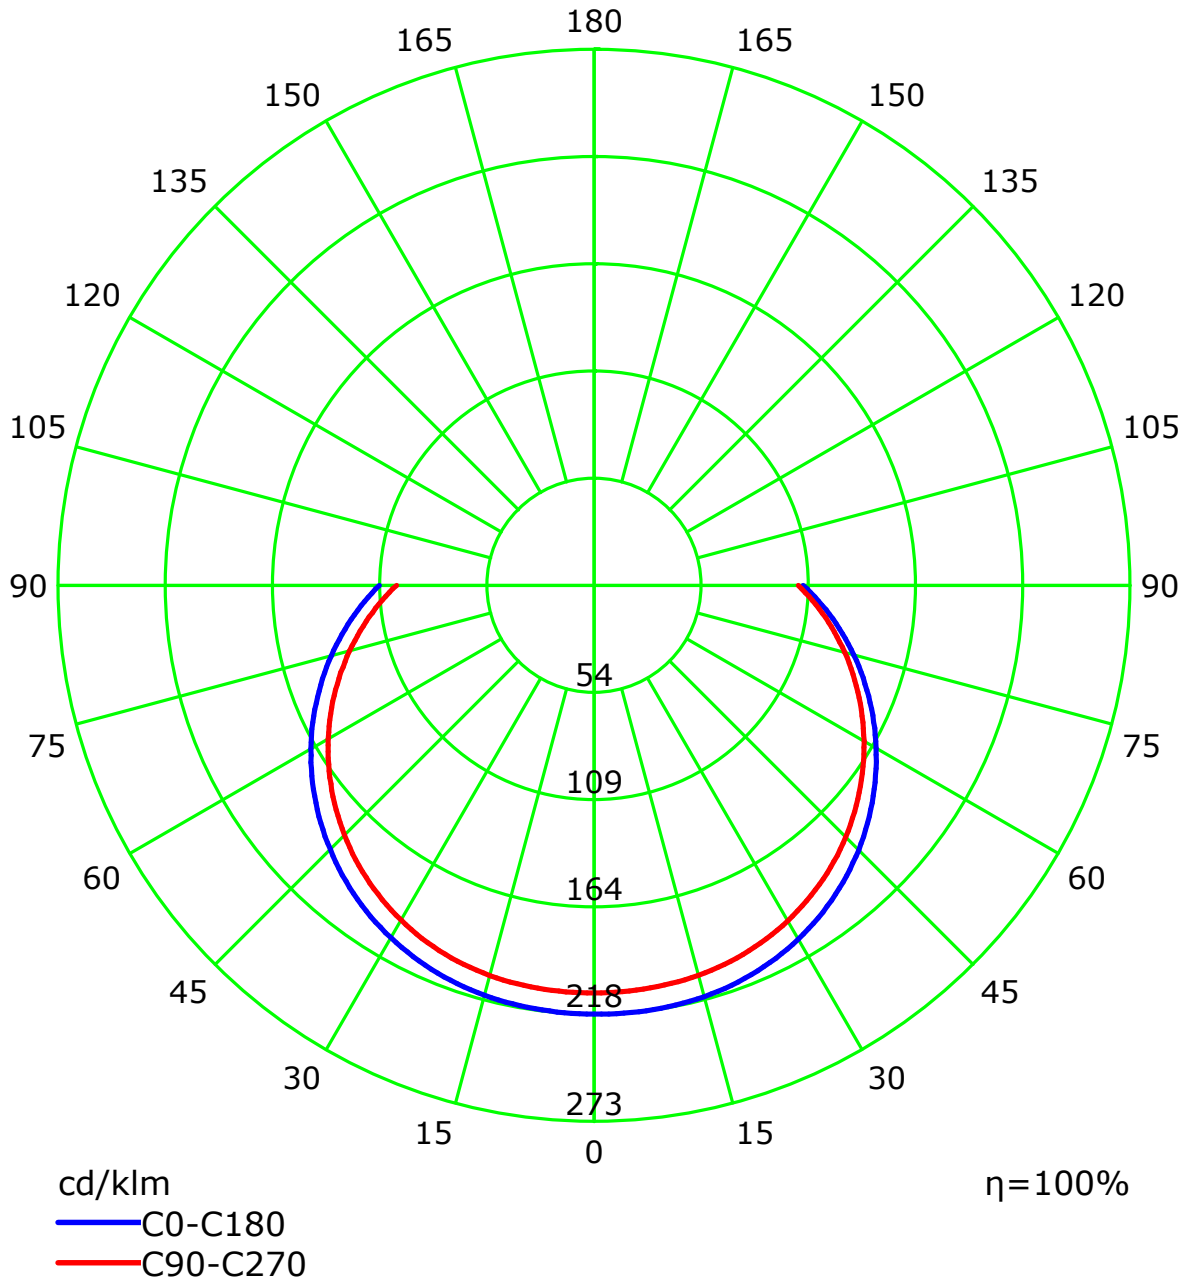

C Plane (°):0.0-360.0: 22.5  
Test Lab:  
Test Type: TYPE C  
Temperature: 常温  
Operator:


Gamma Plane (°):0.0-90.0:1.0  
Test Device: GPM-1600L  
Distance: 7.206 m  
Humidity: 相对湿度65  
Inspector:

## Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	103	96	89	84	100	93	88	82	89	84	79	85	81	77	81	78	75	72
2	92	81	71	64	89	79	70	63	75	68	61	71	65	60	68	63	58	56
3	82	69	59	51	80	67	58	50	64	56	49	61	54	48	58	52	47	45
4	75	60	50	42	72	59	49	41	56	47	41	54	46	40	51	45	39	37
5	68	53	43	35	66	52	42	35	50	41	34	48	40	34	46	39	33	31
6	63	48	37	30	61	47	37	30	45	36	29	43	35	29	41	34	29	26
7	58	43	33	26	56	42	33	26	40	32	26	39	31	25	37	30	25	23
8	54	39	29	23	52	38	29	23	37	29	23	35	28	23	34	27	22	20
9	50	36	27	20	49	35	26	20	34	26	20	33	25	20	31	25	20	18
10	47	33	24	18	46	32	24	18	31	23	18	30	23	18	29	23	18	16

Spacing Criteria (0-180): 1.43  
 Spacing Criteria (90-270): 1.42  
 Spacing Criteria (Diagonal): 1.55


## Curves of Luminaires vs Lighting Area

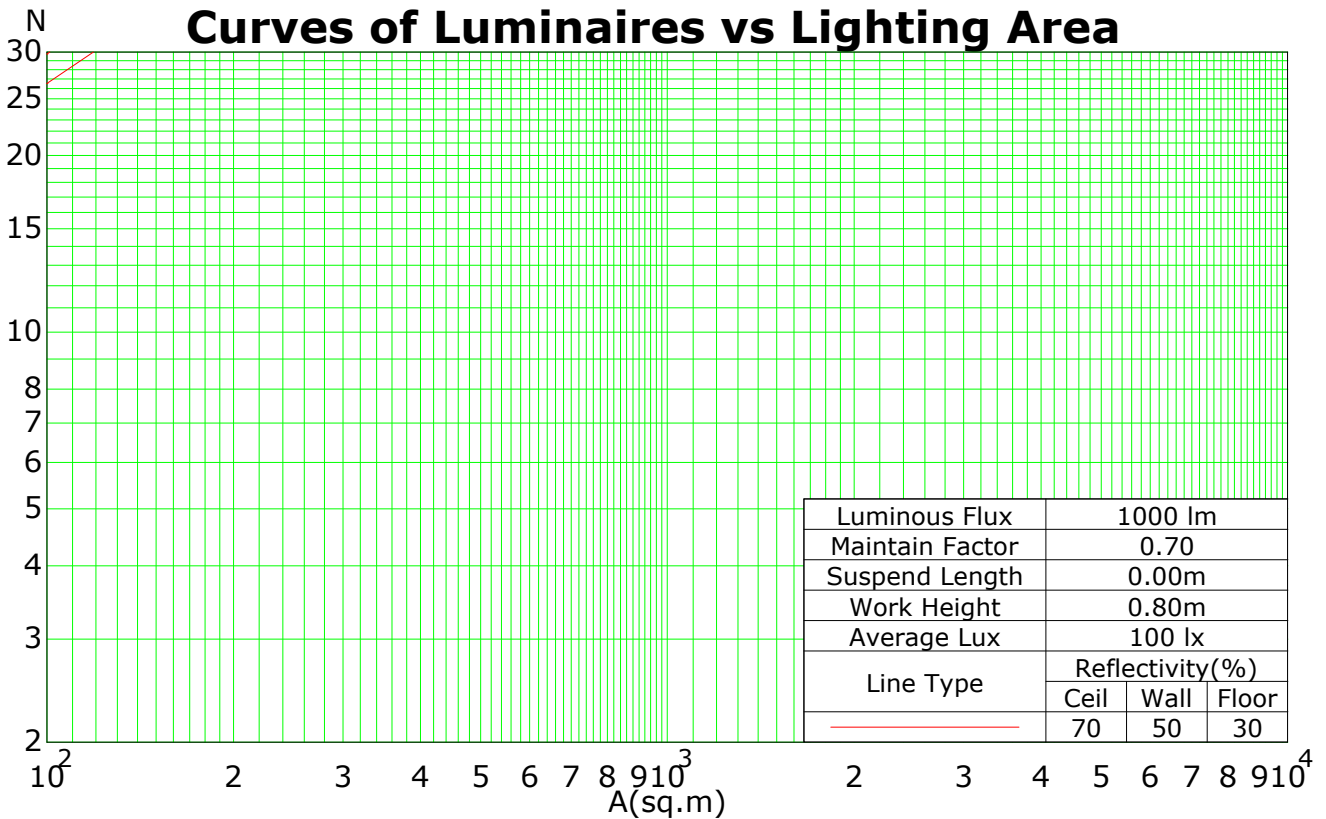

C Plane (°):0.0-360.0: 22.5  
 Test Lab:  
 Test Type: TYPE C  
 Temperature: 常温  
 Operator:

Gamma Plane (°):0.0-90.0:1.0  
 Test Device: GPM-1600L  
 Distance: 7.206 m  
 Humidity: 相对湿度65  
 Inspector:

## Isocandela (rectangle)

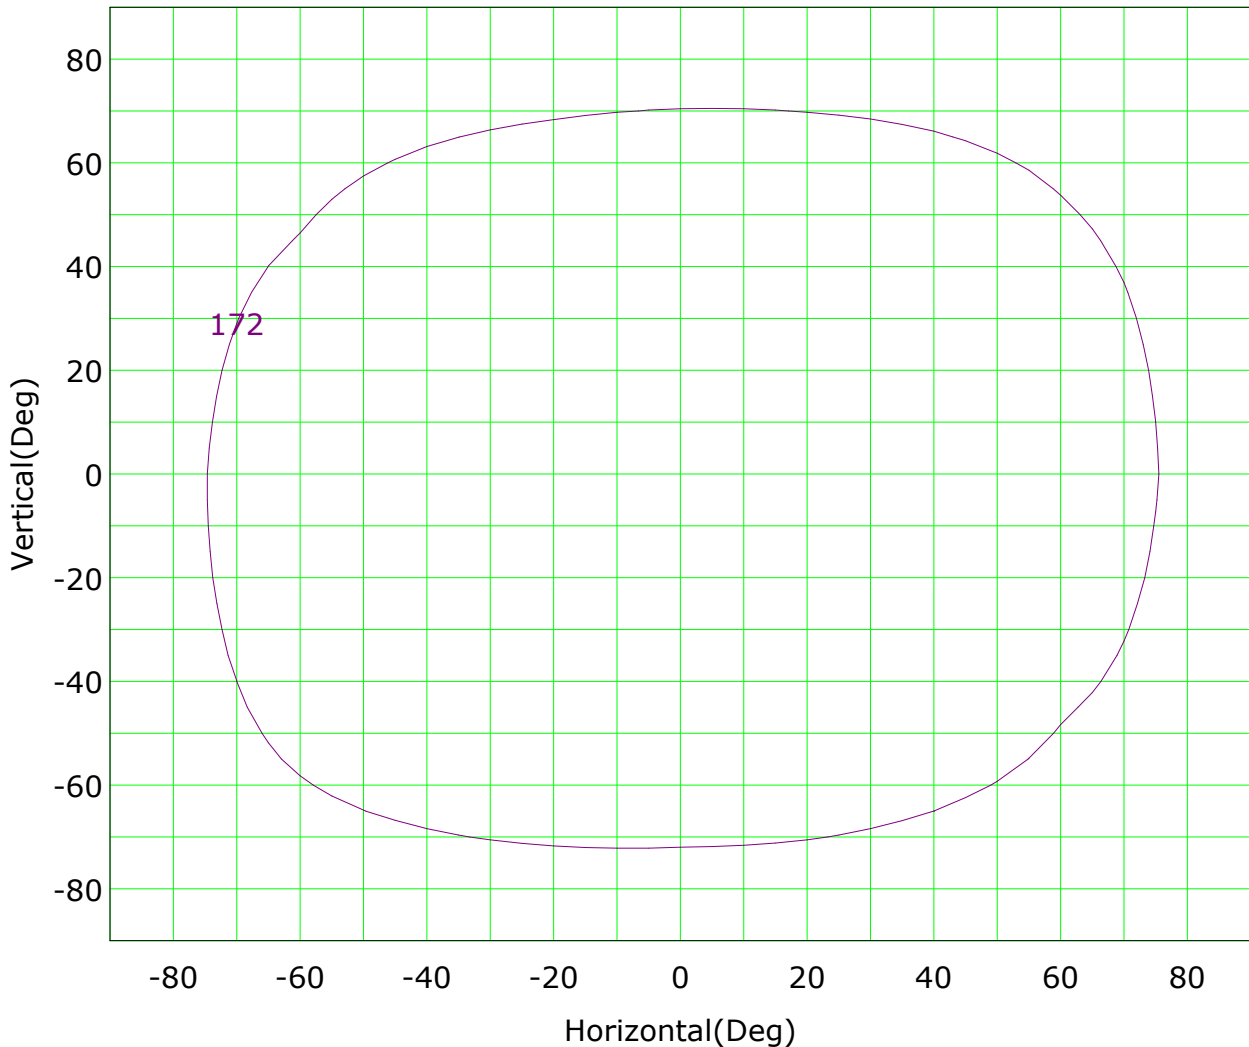

Imax (100%): 272 cd

— ( 1%):	3 cd	— ( 1%):	3 cd
— ( 25%):	68 cd	— ( 40%):	109 cd
— ( 63%):	172 cd	— (100%):	272 cd

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature: 常温

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: GPM-1600L

Distance: 7.206 m

Humidity: 相对湿度65

Inspector:

## Isocandela (sphere)

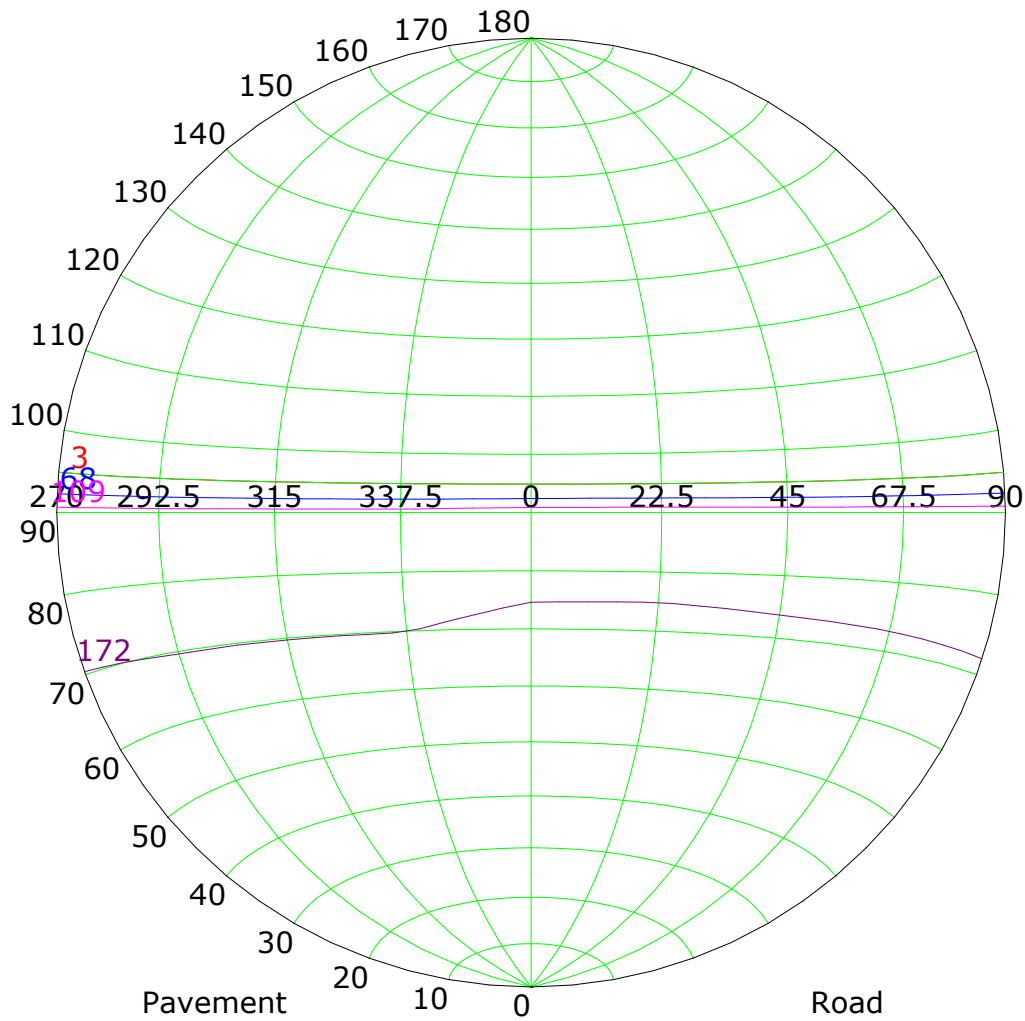

Imax (100%): 272 cd

— ( 1%):	3 cd	— ( 1%):	3 cd
— ( 25%):	68 cd	— ( 40%):	109 cd
— ( 63%):	172 cd	— (100%):	272 cd

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature: 常温

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: GPM-1600L

Distance: 7.206 m

Humidity: 相对湿度65

Inspector:

## IsoLux Plot

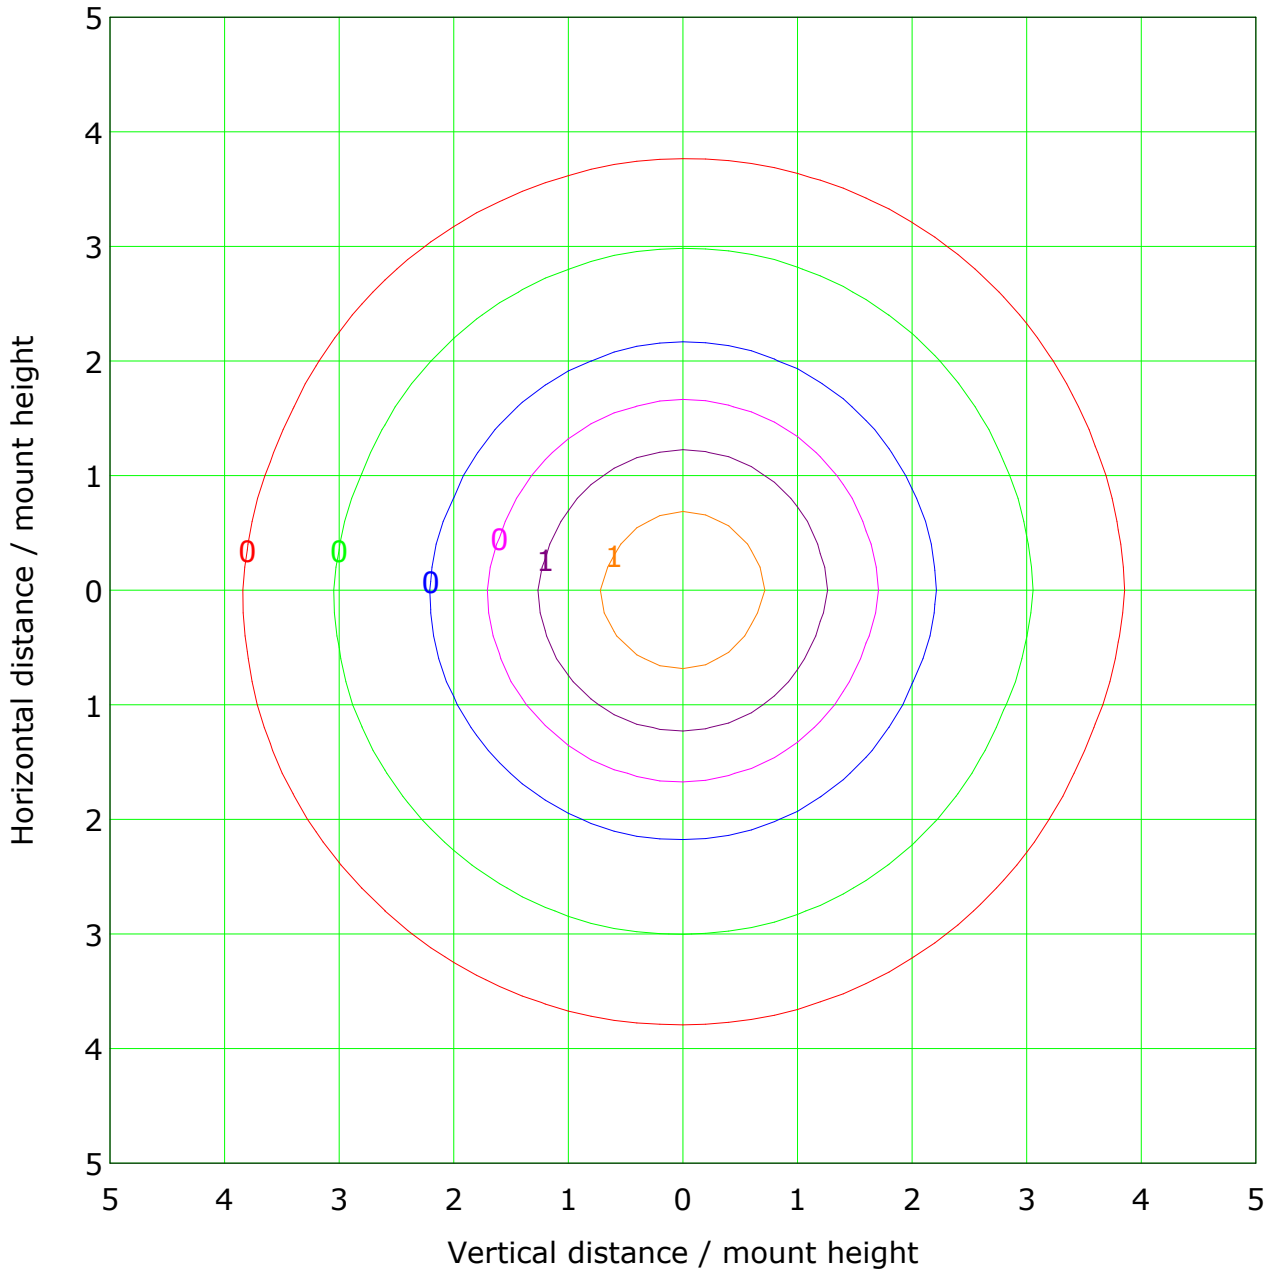

Mounting Height: 10.0m		Max Lux(100%): 2.7 lx	
— ( 1%):	0.0 lx	— ( 2%):	0.1 lx
— ( 5%):	0.1 lx	— ( 10%):	0.3 lx
— ( 20%):	0.5 lx	— ( 50%):	1.4 lx
— (100%):	2.7 lx		

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature: 常温

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L


Distance: 7.206 m

Humidity: 相对湿度65

Inspector:

## Roadway CU Curve

Efficiency(%)

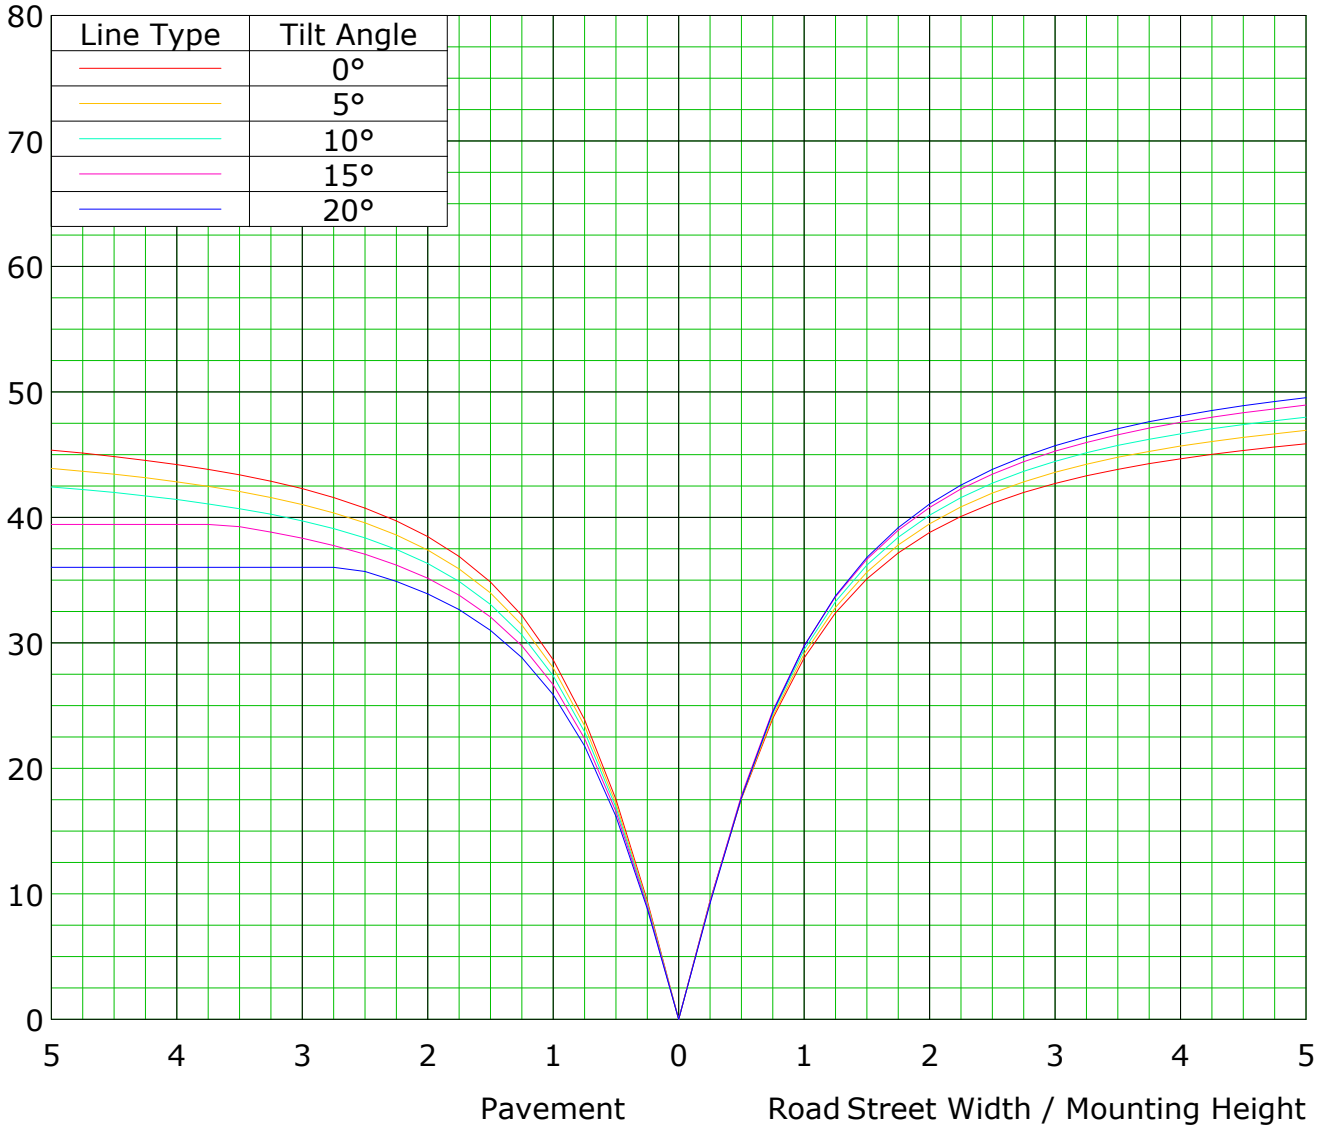

C Plane (°):0.0-360.0: 22.5  
Test Lab:  
Test Type: TYPE C  
Temperature: 常温  
Operator:



Gamma Plane (°):0.0-90.0:1.0  
Test Device: GPM-1600L  
Distance: 7.206 m  
Humidity: 相对湿度65  
Inspector:



## Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
		2000	1000	500	<=300				
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

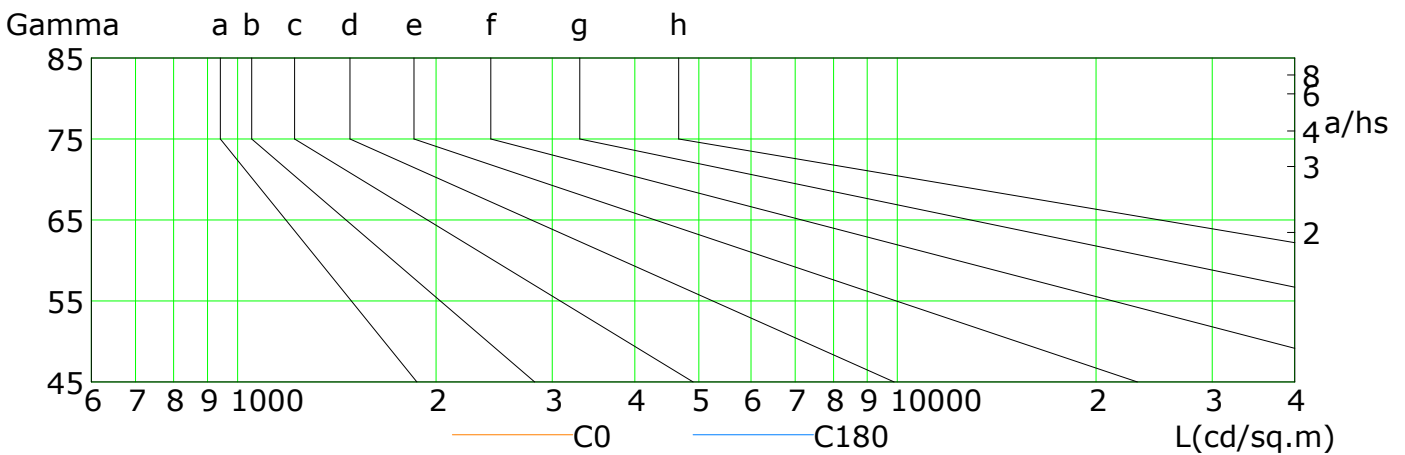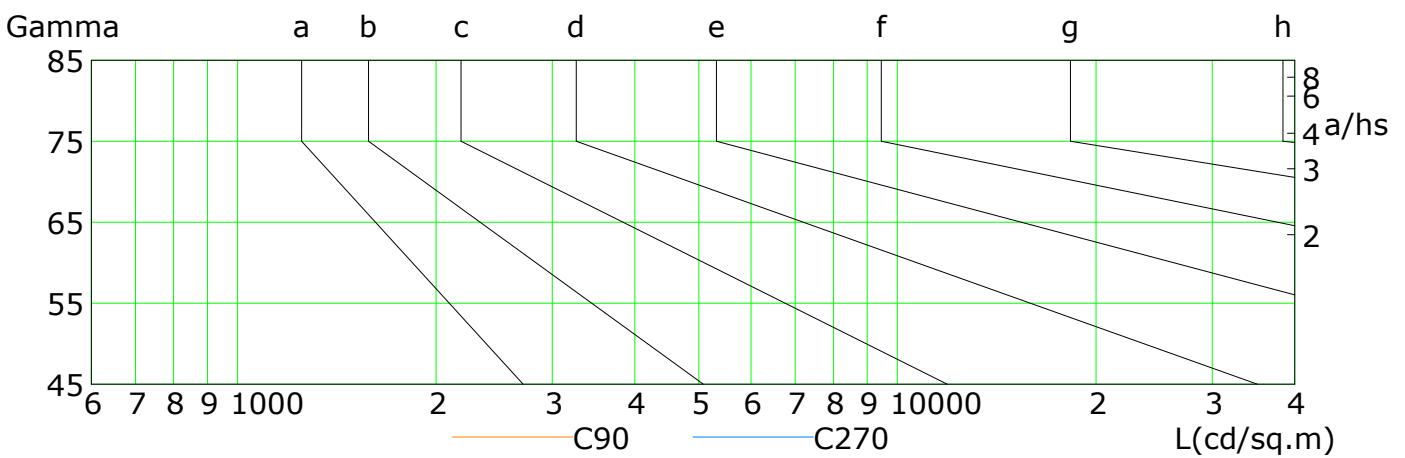

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	238	228	218	207	195	183	171	158	145
C90	226	217	208	198	187	176	165	153	141
C180	237	228	218	208	197	185	173	161	149
C270	224	215	206	195	184	172	161	149	137

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature: 常温

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: GPM-1600L

Distance: 7.206 m

Humidity: 相对湿度65

Inspector:


## Illuminance at a Distance

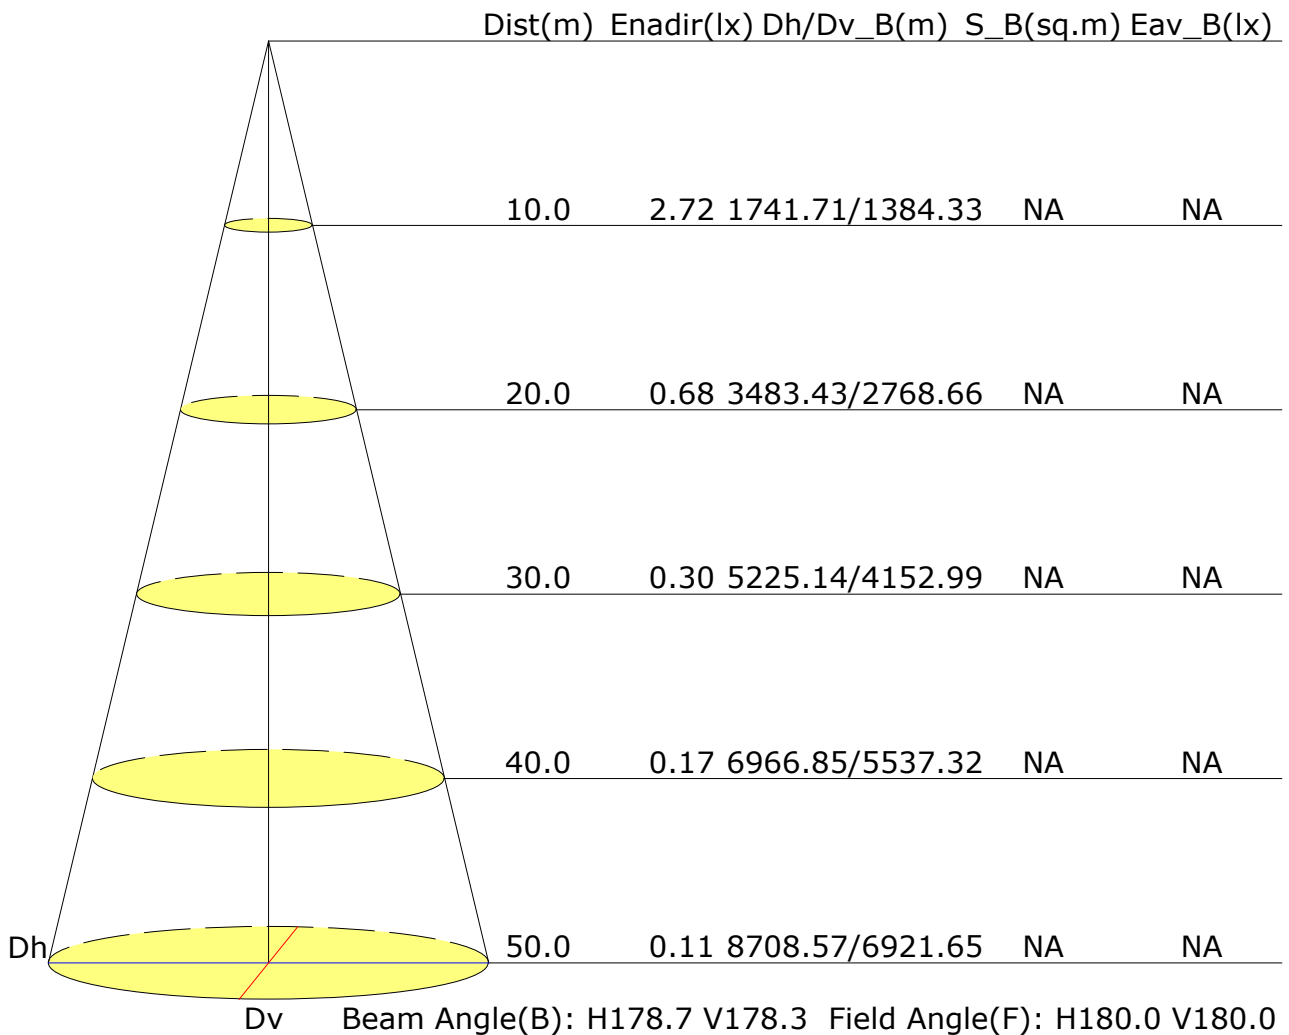

C Plane (°):0.0-360.0: 22.5  
Test Lab:  
Test Type: TYPE C  
Temperature: 常温  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: GPM-1600L  
Distance: 7.206 m  
Humidity: 相对湿度65  
Inspector:

## Vertical IsoLux Plot

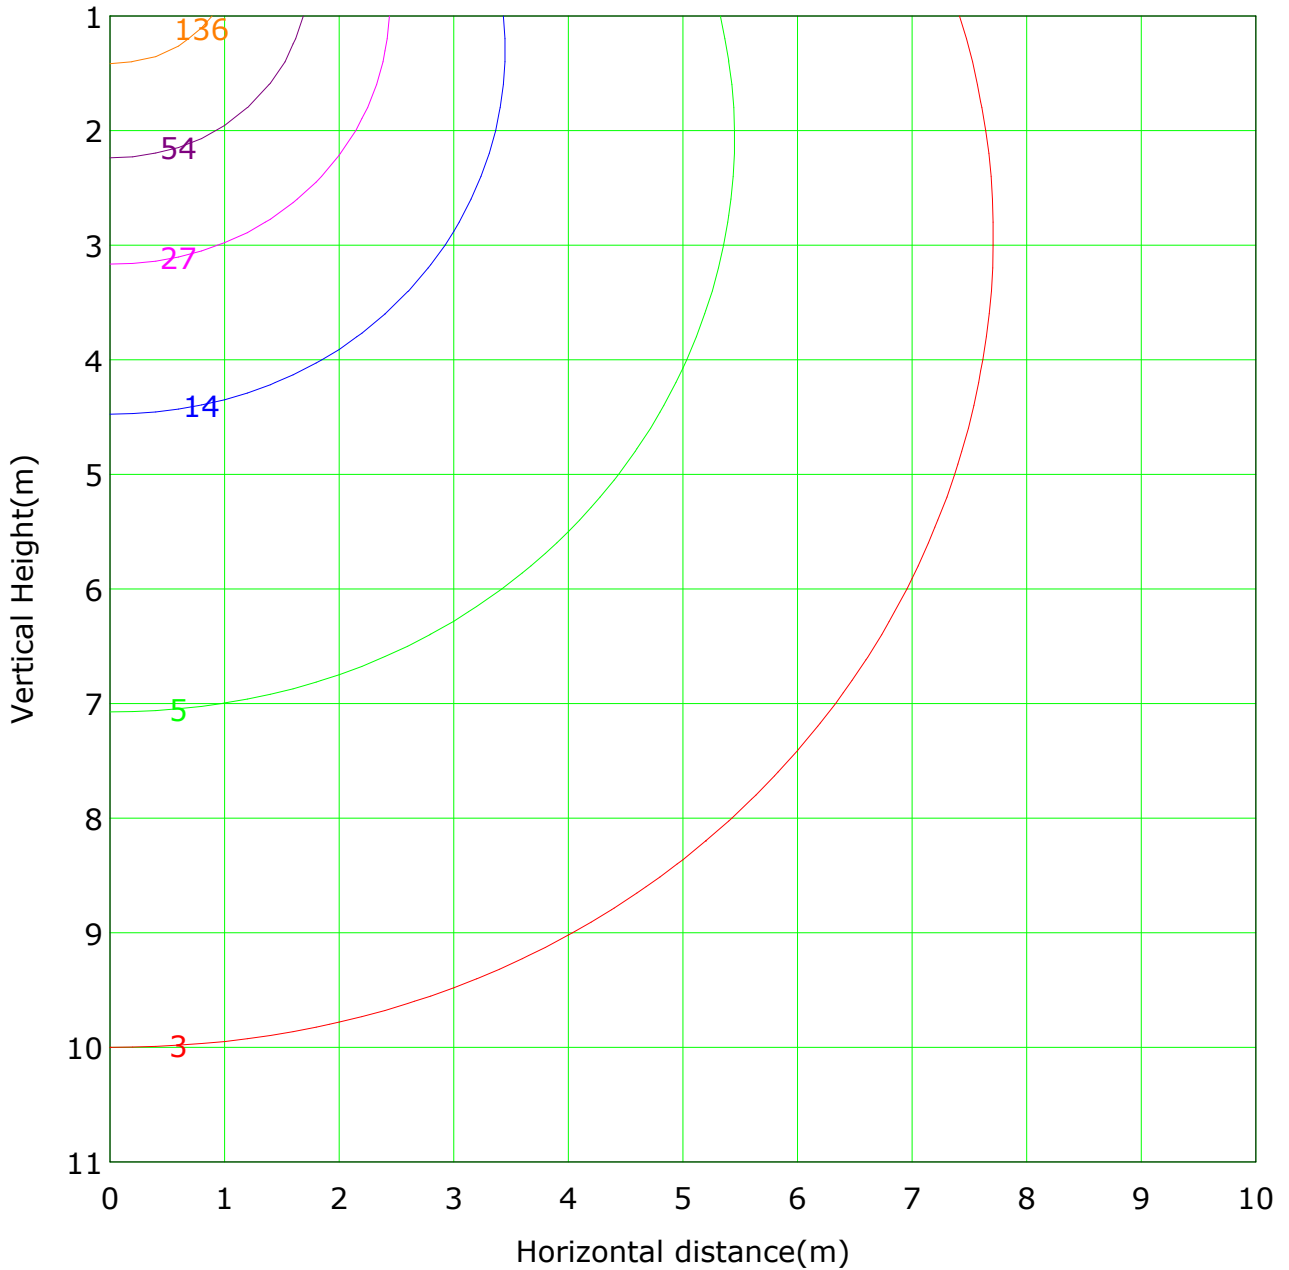

Lowest(m): 1.0m    Highest(m): 11.0m    Max Lux: 272.3 lx

— ( 1%): 2.7 lx	— ( 2%): 5.4 lx
— ( 5%): 13.6 lx	— ( 10%): 27.2 lx
— ( 20%): 54.5 lx	— ( 50%): 136.1 lx
— (100%): 272.3 lx	

C Plane (°):0.0-360.0: 22.5  
Test Lab:  
Test Type: TYPE C  
Temperature: 常温  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: GPM-1600L  
Distance: 7.206 m  
Humidity: 相对湿度65  
Inspector:

# Area Flux Table


Unit: lm

Vertical plane	-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90	Flux(T)	Flux(E)	
-90	0.4	1.1	1.7	2.4	3.0	3.4	3.8	4.0	4.2	4.1	4.0	3.7	3.3	2.8	2.3	1.7	1.0	0.3	47.2	47.2		
-80	0.4	1.1	1.9	2.6	3.3	3.9	4.4	4.7	4.9	4.9	4.7	4.3	3.8	3.2	2.5	1.8	1.1	0.4	53.7	53.7		
-70	0.4	1.2	2.0	2.9	3.7	4.4	5.0	5.4	5.6	5.6	5.3	4.9	4.3	3.5	2.7	1.9	1.1	0.4	60.1	60.1		
-60	0.4	1.2	2.1	3.1	4.0	4.8	5.5	6.0	6.2	6.2	5.9	5.4	4.7	3.9	3.0	2.0	1.2	0.4	66.0	66.0		
-50	0.4	1.3	2.2	3.3	4.3	5.2	6.0	6.5	6.8	6.8	6.4	5.9	5.1	4.2	3.1	2.2	1.2	0.4	71.2	71.2		
-40	0.4	1.3	2.3	3.4	4.6	5.6	6.4	7.0	7.3	7.2	6.9	6.3	5.4	4.4	3.3	2.3	1.3	0.4	75.6	75.6		
-30	0.4	1.3	2.4	3.6	4.8	5.8	6.7	7.3	7.6	7.5	7.2	6.5	5.7	4.6	3.5	2.4	1.3	0.4	79.0	79.0		
-20	0.4	1.4	2.5	3.7	4.9	6.1	7.0	7.6	7.8	7.7	7.4	6.7	5.9	4.8	3.6	2.4	1.3	0.4	81.6	81.6		
-10	0.4	1.4	2.5	3.8	5.1	6.2	7.2	7.8	8.0	7.8	7.6	7.0	6.2	5.0	3.8	2.5	1.3	0.4	83.9	83.9		
0	0.4	1.4	2.5	3.8	5.0	6.1	7.0	7.5	7.8	8.0	7.8	7.2	6.3	5.1	3.8	2.5	1.4	0.4	84.1	84.1		
10	0.4	1.3	2.5	3.7	4.8	5.8	6.7	7.3	7.7	7.8	7.6	7.1	6.2	5.0	3.7	2.5	1.3	0.4	81.9	81.9		
20	0.4	1.3	2.4	3.5	4.6	5.6	6.5	7.2	7.5	7.6	7.4	6.8	6.0	4.9	3.7	2.4	1.3	0.4	79.5	79.5		
30	0.4	1.3	2.4	3.5	4.6	5.6	6.5	7.2	7.5	7.6	7.4	6.8	6.0	4.9	3.7	2.4	1.3	0.4	79.5	79.5		
40	0.4	1.3	2.3	3.3	4.4	5.4	6.3	6.9	7.2	7.3	7.0	6.5	5.7	4.7	3.5	2.4	1.3	0.4	76.3	76.3		
50	0.4	1.2	2.2	3.2	4.2	5.1	5.9	6.5	6.8	6.9	6.6	6.1	5.3	4.4	3.4	2.3	1.3	0.4	72.1	72.1		
60	0.4	1.2	2.1	3.0	3.9	4.8	5.5	6.0	6.3	6.3	6.1	5.6	4.9	4.1	3.2	2.2	1.2	0.4	67.1	67.1		
70	0.4	1.1	2.0	2.8	3.6	4.4	5.0	5.4	5.7	5.7	5.5	5.1	4.5	3.8	2.9	2.1	1.2	0.4	61.3	61.3		
80	0.4	1.1	1.8	2.6	3.3	3.9	4.4	4.8	5.0	5.0	4.8	4.5	4.0	3.4	2.7	1.9	1.1	0.4	55.2	55.2		
90	0.4	1.1	1.7	2.3	2.9	3.4	3.9	4.1	4.3	4.3	4.2	3.9	3.5	3.0	2.4	1.8	1.1	0.4	48.8	48.8		
Flux(T)	6.9	22.2	39.1	56.9	74.3	90.2	103.1	112.1	116.6	116.7	112.4	103.5	90.7	74.8	57.2	39.2	22.1	6.8	1245			
Flux(E)	6.9	22.2	39.1	56.9	74.3	90.2	103.1	112.1	116.6	116.7	112.4	103.5	90.7	74.8	57.2	39.2	22.1	6.8			1245	

Gamma Plane (°): 0.0-90.0:1.0  
Test Device: GPM-1600L  
Distance: 7.206 m  
Humidity: 相对湿度65  
Inspector:

C Plane (°): 0.0-360.0: 22.5  
Test Lab:  
Test Type: TYPE C  
Temperature: 常温  
Operator:

## The Average Illuminance Effective Figure

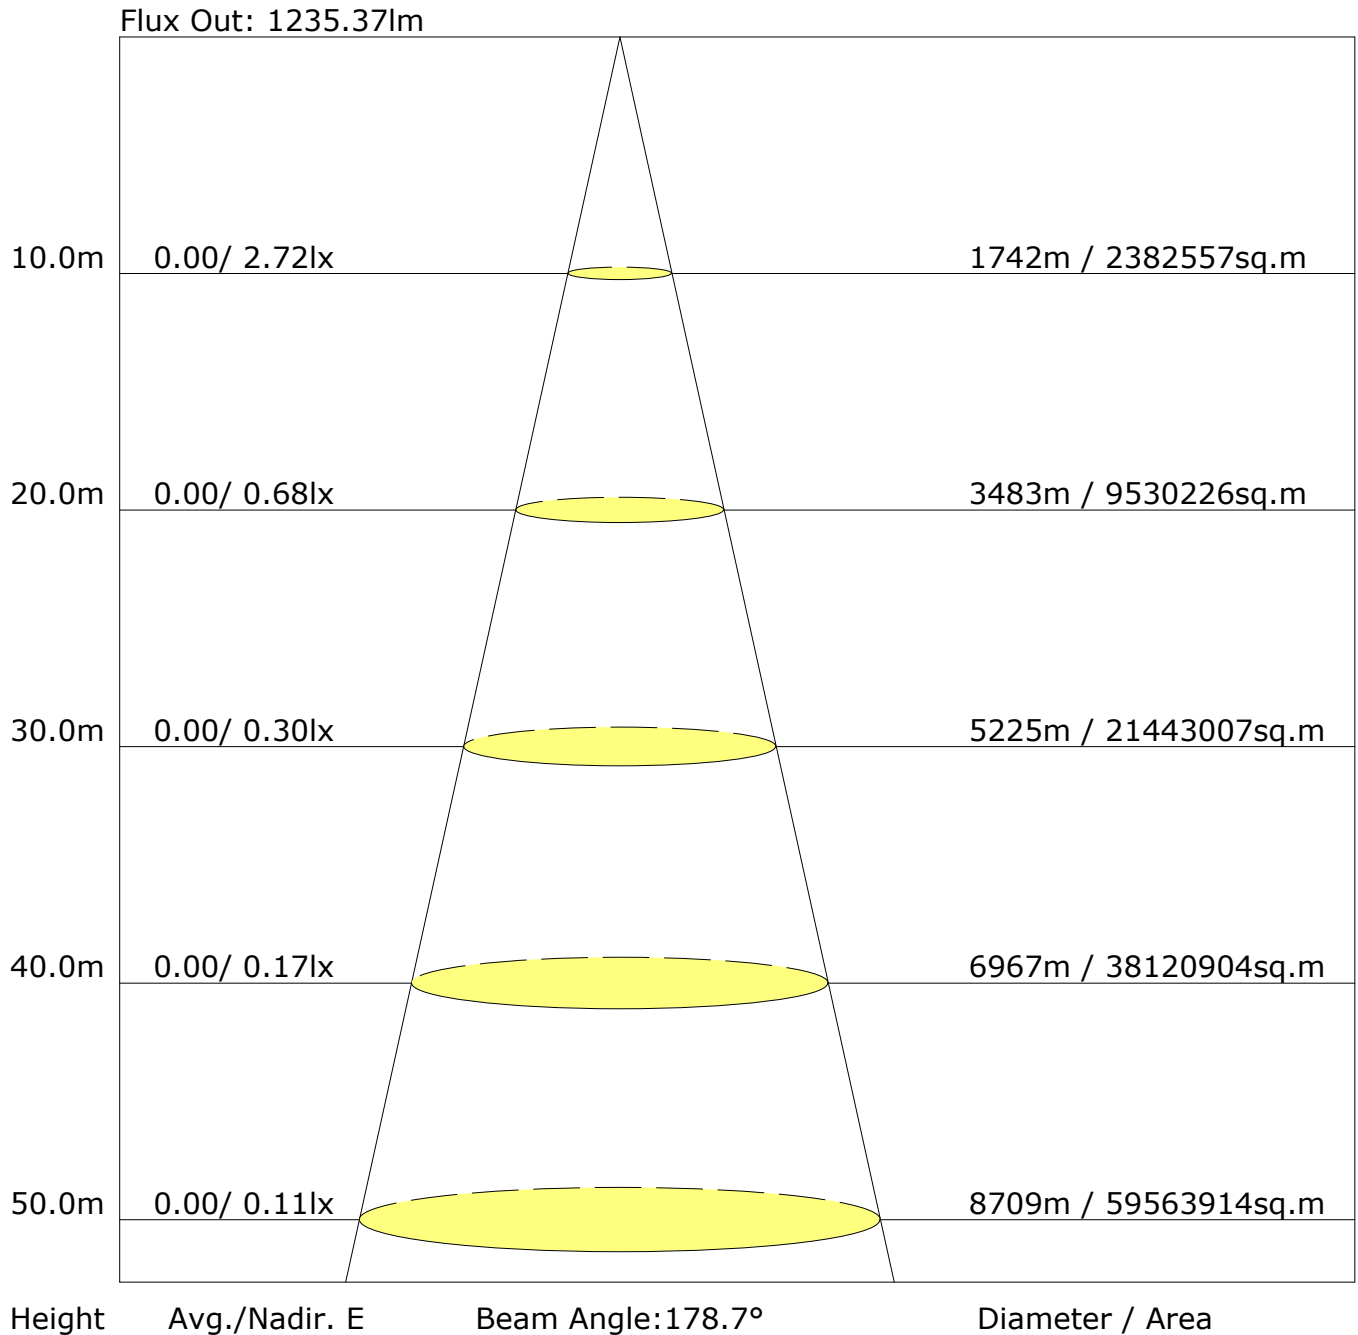

C Plane (°):0.0-360.0: 22.5  
Test Lab:  
Test Type: TYPE C  
Temperature: 常温  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: GPM-1600L  
Distance: 7.206 m  
Humidity: 相对湿度65  
Inspector:

## UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
3H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=4H Y=2H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
3H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=8H Y=4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=12H Y=4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
Variations with the observer position at spacings:										
S=1.0H	-1.\$/-1.\$					-1.\$/-1.\$				
S=1.5H	-1.\$/-1.\$					-1.\$/-1.\$				
S=2.0H	-1.\$/-1.\$					-1.\$/-1.\$				

Calculate in accordance with CIE Pub.117. The table is revised with 1245lm ( $8\log(F/F_0) = 0.8$ ).

C Plane (°):0.0-360.0: 22.5  
 Test Lab:  
 Test Type: TYPE C  
 Temperature: 常温  
 Operator:

Gamma Plane (°):0.0-90.0:1.0  
 Test Device: GPM-1600L  
 Distance: 7.206 m  
 Humidity: 相对湿度65  
 Inspector:

**FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM**

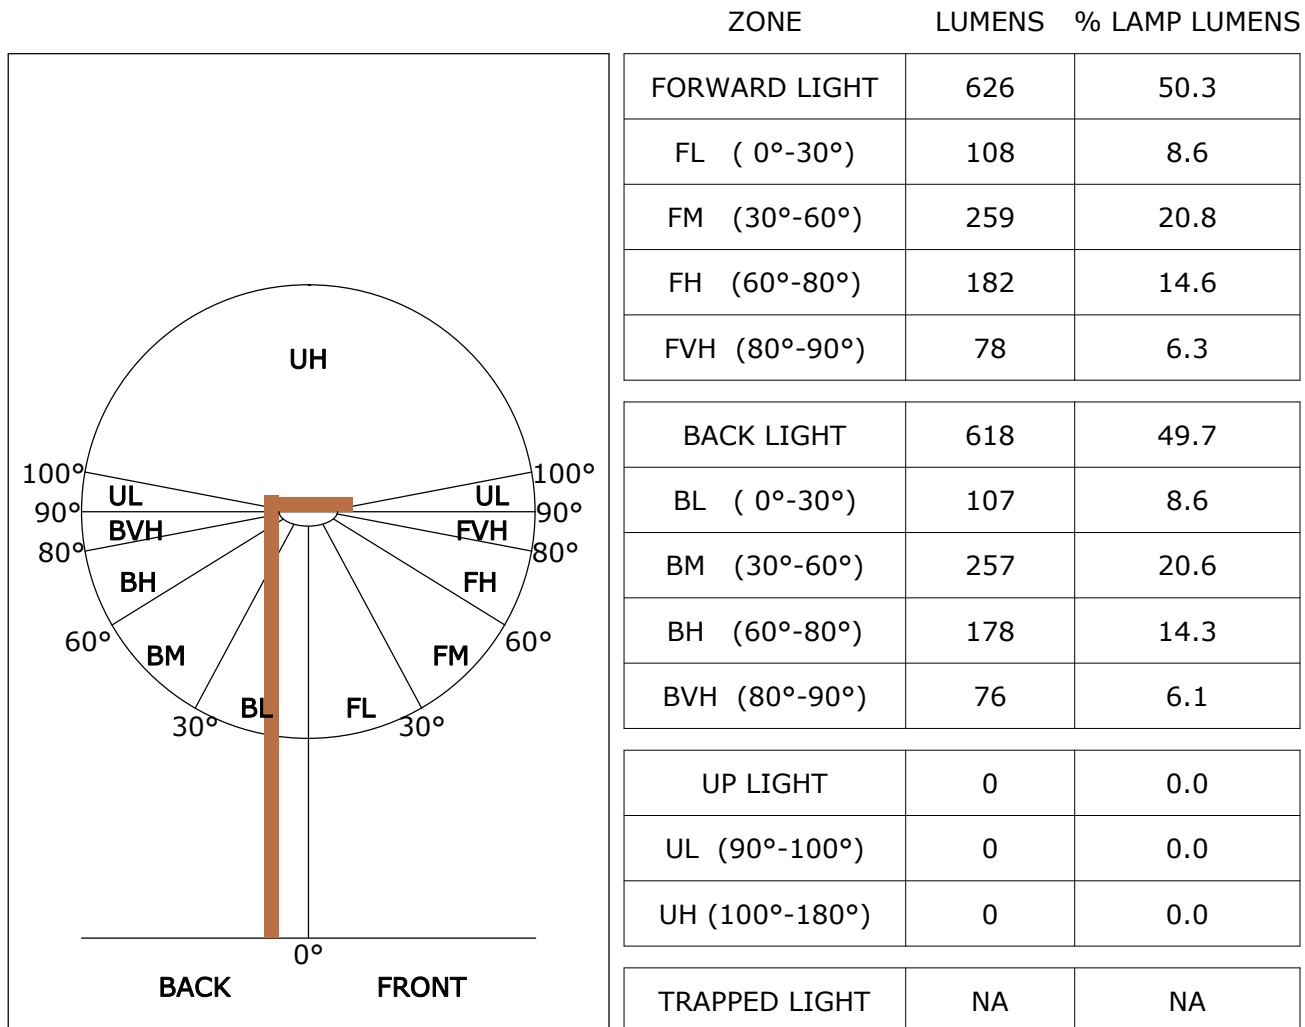


BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B1 U2 G1
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B1 U2 G1

C Plane (°):0.0-360.0: 22.5  
 Test Lab:  
 Test Type: TYPE C  
 Temperature: 常温  
 Operator:

Gamma Plane (°):0.0-90.0:1.0  
 Test Device: GPM-1600L  
 Distance: 7.206 m  
 Humidity: 相对湿度65  
 Inspector:

## LCS Graph

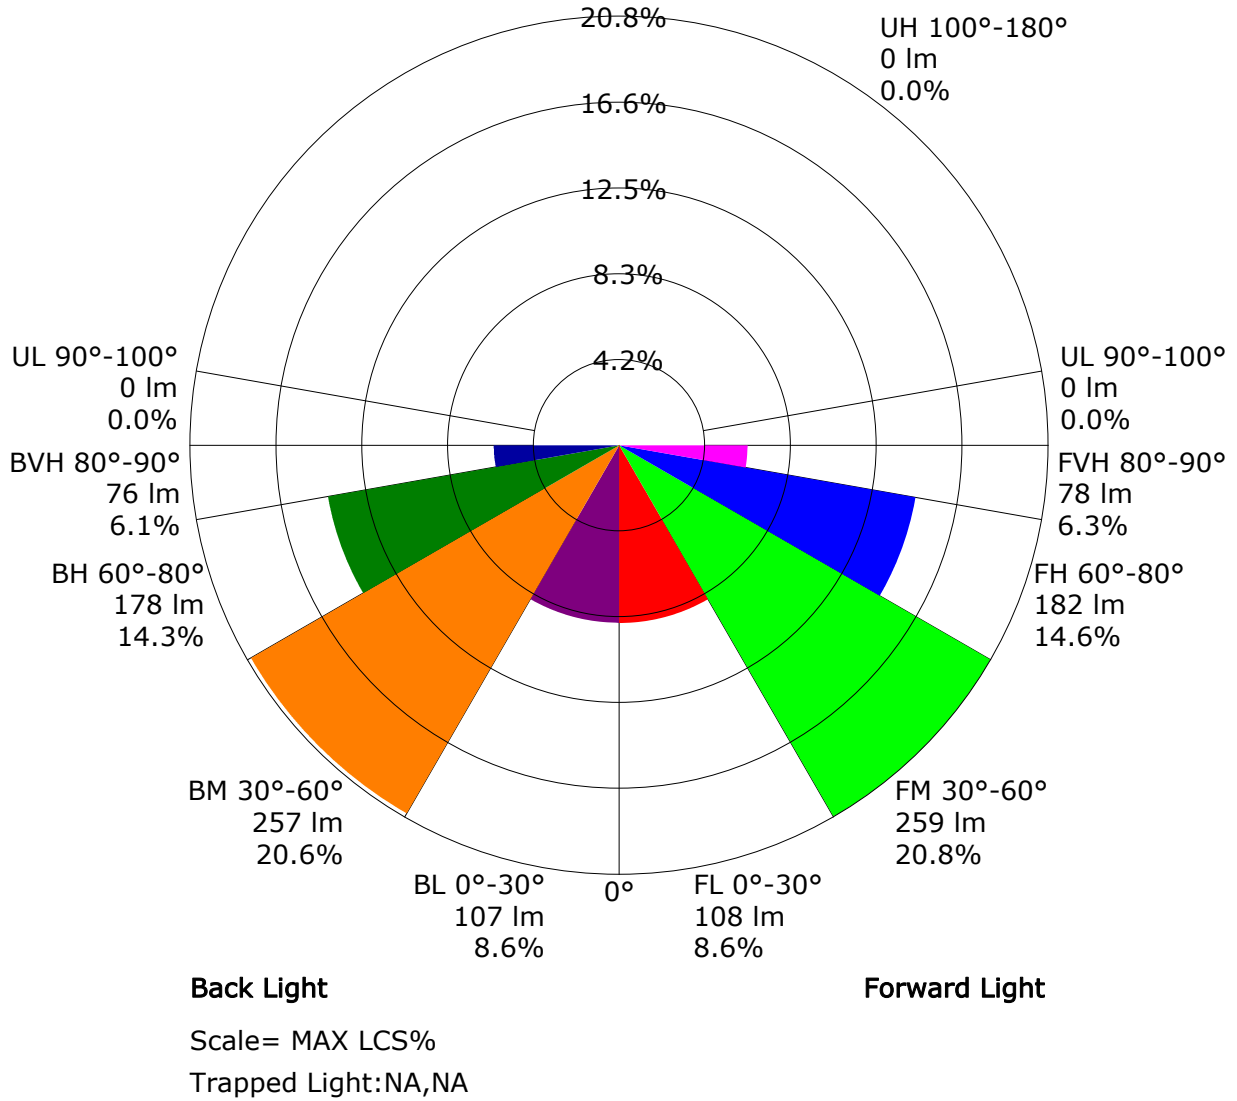



## Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 1.50									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.48	0.56	0.63	0.68	0.76	0.82	0.86	0.91	0.95	
		0.30	0.39	0.46	0.54	0.59	0.68	0.74	0.78	0.85	0.89	
		0.20	0.32	0.39	0.47	0.52	0.61	0.67	0.72	0.79	0.84	
0.50	0.50	0.20	0.46	0.53	0.60	0.65	0.73	0.78	0.82	0.87	0.91	
		0.30	0.38	0.45	0.52	0.58	0.65	0.71	0.75	0.82	0.86	
		0.20	0.32	0.39	0.46	0.51	0.59	0.65	0.70	0.77	0.82	
0.30	0.50	0.20	0.45	0.51	0.58	0.63	0.69	0.74	0.78	0.83	0.86	
		0.30	0.37	0.44	0.51	0.56	0.63	0.69	0.73	0.78	0.83	
		0.20	0.32	0.38	0.45	0.50	0.58	0.64	0.68	0.75	0.79	
0.00	0.00	0.00	0.29	0.36	0.42	0.47	0.54	0.60	0.64	0.70	0.74	
<p>Rating:14W Photometrically tested without ceiling board.                      Multiply UF values by service correction factors                      Calculate in accordance with CIBSE Technical Memorandum NO.5 1980</p>												

## Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 1.50									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	1.13	1.00	0.87	0.78	0.65	0.56	0.50	0.41	0.34	
	0.30		0.94	0.85	0.76	0.69	0.59	0.52	0.46	0.38	0.33	
	0.20		0.81	0.74	0.67	0.62	0.54	0.48	0.43	0.36	0.31	
0.50	0.50	0.20	1.09	0.96	0.84	0.76	0.63	0.57	0.48	0.39	0.33	
	0.30		0.93	0.83	0.74	0.68	0.58	0.50	0.45	0.37	0.32	
	0.20		0.80	0.74	0.67	0.61	0.53	0.47	0.42	0.35	0.30	
0.30	0.50	0.20	1.07	0.93	0.81	0.73	0.61	0.53	0.47	0.38	0.32	
	0.30		0.91	0.82	0.73	0.66	0.56	0.49	0.44	0.36	0.31	
	0.20		0.80	0.73	0.66	0.61	0.52	0.46	0.41	0.35	0.30	
0.00	0.00	0.00	0.71	0.65	0.58	0.53	0.46	0.40	0.36	0.30	0.26	
Rating:14W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

## Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 1.50									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.17	0.19	0.20	0.21	0.22	0.22	0.22	0.23	0.23	
	0.30		0.10	0.11	0.13	0.14	0.15	0.16	0.17	0.18	0.19	
	0.20		0.04	0.05	0.07	0.08	0.10	0.11	0.12	0.14	0.15	
0.50	0.50	0.20	0.17	0.18	0.19	0.20	0.21	0.21	0.22	0.22	0.22	
	0.30		0.10	0.11	0.12	0.13	0.15	0.16	0.16	0.18	0.18	
	0.20		0.04	0.05	0.07	0.08	0.09	0.11	0.12	0.14	0.15	
0.30	0.50	0.20	0.16	0.18	0.19	0.19	0.20	0.20	0.21	0.21	0.21	
	0.30		0.09	0.11	0.12	0.13	0.14	0.15	0.16	0.17	0.18	
	0.20		0.04	0.05	0.07	0.08	0.09	0.11	0.12	0.13	0.14	
0.00	0.00	0.00	NA	NA	NA	NA	NA	NA	NA	NA	NA	
<p>Rating:14W Photometrically tested without ceiling board.                      Multiply UF values by service correction factors                      Calculate in accordance with CIBSE Technical Memorandum NO.5 1980</p>												

## Zonal Lumen

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	261.4	0.3	0.3	0.02	0.02
1.0-2.0	261.3	0.8	1.0	0.06	0.08
2.0-3.0	261.3	1.2	2.3	0.10	0.18
3.0-4.0	261.2	1.7	4.0	0.14	0.32
4.0-5.0	261.2	2.2	6.2	0.18	0.50
5.0-6.0	261.1	2.7	9.0	0.22	0.72
6.0-7.0	261.0	3.2	12.2	0.26	0.98
7.0-8.0	260.8	3.7	16.0	0.30	1.28
8.0-9.0	260.7	4.2	20.2	0.34	1.62
9.0-10.0	260.5	4.7	24.9	0.38	2.00
10.0-11.0	260.3	5.2	30.1	0.42	2.42
11.0-12.0	260.1	5.7	35.8	0.46	2.88
12.0-13.0	259.8	6.2	42.0	0.50	3.37
13.0-14.0	259.5	6.6	48.6	0.53	3.90
14.0-15.0	259.2	7.1	55.7	0.57	4.48
15.0-16.0	258.8	7.6	63.3	0.61	5.09
16.0-17.0	258.4	8.0	71.3	0.65	5.73
17.0-18.0	257.9	8.5	79.9	0.68	6.42
18.0-19.0	257.4	9.0	88.8	0.72	7.13
19.0-20.0	256.8	9.4	98.2	0.76	7.89
20.0-21.0	256.3	9.8	108.1	0.79	8.68
21.0-22.0	255.6	10.3	118.3	0.83	9.51
22.0-23.0	254.9	10.7	129.0	0.86	10.37
23.0-24.0	254.2	11.1	140.1	0.89	11.26
24.0-25.0	253.4	11.5	151.7	0.93	12.18
25.0-26.0	252.6	11.9	163.6	0.96	13.14
26.0-27.0	251.7	12.3	175.9	0.99	14.13
27.0-28.0	250.8	12.7	188.6	1.02	15.15
28.0-29.0	249.9	13.1	201.7	1.05	16.20
29.0-30.0	248.9	13.4	215.1	1.08	17.28
30.0-31.0	247.8	13.8	228.9	1.11	18.39
31.0-32.0	246.7	14.1	243.1	1.14	19.53
32.0-33.0	245.6	14.5	257.5	1.16	20.69
33.0-34.0	244.4	14.8	272.3	1.19	21.88
34.0-35.0	243.2	15.1	287.4	1.21	23.09
35.0-36.0	241.9	15.4	302.8	1.24	24.33

C Plane (°):0.0-360.0: 22.5  
 Test Lab:  
 Test Type: TYPE C  
 Temperature: 常温  
 Operator:

Gamma Plane (°):0.0-90.0:1.0  
 Test Device: GPM-1600L  
 Distance: 7.206 m  
 Humidity: 相对湿度65  
 Inspector:

## Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	240.6	15.7	318.5	1.26	25.59
37.0-38.0	239.2	16.0	334.5	1.28	26.87
38.0-39.0	237.8	16.2	350.7	1.30	28.18
39.0-40.0	236.4	16.5	367.2	1.32	29.50
40.0-41.0	234.9	16.7	383.9	1.34	30.85
41.0-42.0	233.4	17.0	400.9	1.36	32.21
42.0-43.0	231.8	17.2	418.1	1.38	33.59
43.0-44.0	230.1	17.4	435.4	1.40	34.98
44.0-45.0	228.5	17.6	453.0	1.41	36.39
45.0-46.0	226.8	17.7	470.7	1.43	37.82
46.0-47.0	225.1	17.9	488.7	1.44	39.26
47.0-48.0	223.3	18.1	506.7	1.45	40.71
48.0-49.0	221.5	18.2	524.9	1.46	42.17
49.0-50.0	219.8	18.3	543.2	1.47	43.64
50.0-51.0	217.9	18.4	561.7	1.48	45.12
51.0-52.0	216.0	18.5	580.2	1.49	46.61
52.0-53.0	214.1	18.6	598.8	1.50	48.11
53.0-54.0	212.1	18.7	617.5	1.50	49.61
54.0-55.0	210.2	18.8	636.3	1.51	51.12
55.0-56.0	208.1	18.8	655.1	1.51	52.63
56.0-57.0	206.1	18.8	673.9	1.51	54.14
57.0-58.0	204.1	18.9	692.8	1.52	55.66
58.0-59.0	202.0	18.9	711.7	1.52	57.18
59.0-60.0	199.8	18.9	730.6	1.52	58.69
60.0-61.0	197.7	18.9	749.5	1.52	60.21
61.0-62.0	195.5	18.8	768.3	1.51	61.72
62.0-63.0	193.4	18.8	787.1	1.51	63.24
63.0-64.0	191.2	18.8	805.9	1.51	64.74
64.0-65.0	188.9	18.7	824.6	1.50	66.24
65.0-66.0	186.7	18.6	843.2	1.50	67.74
66.0-67.0	184.4	18.5	861.8	1.49	69.23
67.0-68.0	182.2	18.5	880.2	1.48	70.71
68.0-69.0	179.9	18.4	898.6	1.47	72.19
69.0-70.0	177.5	18.2	916.8	1.47	73.65
70.0-71.0	175.3	18.1	934.9	1.46	75.11
71.0-72.0	172.9	18.0	952.9	1.44	76.55

C Plane (°):0.0-360.0: 22.5  
 Test Lab:  
 Test Type: TYPE C  
 Temperature: 常温  
 Operator:

Gamma Plane (°):0.0-90.0:1.0  
 Test Device: GPM-1600L  
 Distance: 7.206 m  
 Humidity: 相对湿度65  
 Inspector:

### Zonal Lumen (Continue 2)

Gamma [°]	I <sub>mean</sub> [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	170.6	17.8	970.7	1.43	77.99
73.0-74.0	168.3	17.7	988.4	1.42	79.41
74.0-75.0	165.9	17.5	1006.0	1.41	80.82
75.0-76.0	163.6	17.4	1023.3	1.40	82.21
76.0-77.0	161.2	17.2	1040.5	1.38	83.59
77.0-78.0	158.8	17.0	1057.5	1.37	84.96
78.0-79.0	156.5	16.8	1074.3	1.35	86.31
79.0-80.0	154.1	16.6	1090.9	1.33	87.64
80.0-81.0	151.7	16.4	1107.3	1.32	88.96
81.0-82.0	149.3	16.2	1123.5	1.30	90.26
82.0-83.0	146.9	16.0	1139.5	1.28	91.55
83.0-84.0	144.6	15.7	1155.3	1.27	92.81
84.0-85.0	142.1	15.5	1170.8	1.25	94.06
85.0-86.0	139.7	15.3	1186.1	1.23	95.29
86.0-87.0	137.5	15.0	1201.1	1.21	96.50
87.0-88.0	135.1	14.8	1215.9	1.19	97.68
88.0-89.0	132.6	14.5	1230.4	1.17	98.85
89.0-90.0	130.3	14.3	1244.7	1.15	100.00

C Plane (°):0.0-360.0: 22.5  
Test Lab:  
Test Type: TYPE C  
Temperature: 常温  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: GPM-1600L  
Distance: 7.206 m  
Humidity: 相对湿度65  
Inspector:

## Candlepower Table

Unit: cd

G\C	C0.0	C22.5	C45.0	C67.5	C90.0	C112.5	C135.0	C157.5	C180.0	C202.5
G0.0	272.3	267.4	263.6	260.9	258.8	257.1	255.8	254.8	272.3	267.4
G1.0	272.3	267.5	263.6	261.0	258.8	257.1	255.8	254.7	272.3	267.3
G2.0	272.3	267.5	263.6	261.0	258.7	257.1	255.8	254.7	272.2	267.3
G3.0	272.3	267.5	263.6	260.9	258.7	257.0	255.7	254.6	272.2	267.1
G4.0	272.3	267.5	263.6	260.9	258.6	256.9	255.6	254.5	272.0	267.0
G5.0	272.3	267.5	263.5	260.8	258.5	256.9	255.5	254.4	272.0	266.9
G6.0	272.2	267.5	263.5	260.8	258.4	256.6	255.3	254.2	271.8	266.7
G7.0	272.2	267.5	263.4	260.7	258.2	256.5	255.1	254.1	271.6	266.5
G8.0	272.0	267.4	263.3	260.5	258.1	256.3	254.9	253.9	271.4	266.3
G9.0	271.9	267.3	263.1	260.4	257.9	256.2	254.7	253.7	271.3	266.1
G10.0	271.7	267.2	263.0	260.3	257.8	256.0	254.5	253.5	271.0	265.8
G11.0	271.6	267.1	262.8	260.1	257.5	255.7	254.2	253.2	270.8	265.5
G12.0	271.3	266.9	262.6	259.8	257.3	255.5	253.9	253.0	270.5	265.2
G13.0	271.0	266.7	262.4	259.6	257.0	255.2	253.7	252.7	270.2	264.8
G14.0	270.7	266.5	262.1	259.3	256.7	254.9	253.3	252.3	269.8	264.4
G15.0	270.4	266.2	261.8	259.0	256.3	254.5	252.9	251.9	269.5	264.0
G16.0	269.9	265.9	261.4	258.6	255.9	254.1	252.5	251.5	269.0	263.5
G17.0	269.6	265.5	261.1	258.2	255.5	253.8	252.1	251.1	268.5	263.0
G18.0	269.1	265.0	260.7	257.8	255.1	253.3	251.6	250.6	268.0	262.4
G19.0	268.5	264.6	260.1	257.2	254.6	252.8	251.0	250.1	267.4	261.8
G20.0	268.0	264.1	259.7	256.8	254.0	252.2	250.5	249.5	266.9	261.2
G21.0	267.3	263.5	259.1	256.2	253.4	251.6	249.9	248.8	266.3	260.6
G22.0	266.7	263.0	258.5	255.6	252.8	251.0	249.3	248.2	265.6	259.8
G23.0	265.9	262.3	257.9	254.9	252.1	250.3	248.6	247.6	264.8	259.1
G24.0	265.1	261.5	257.1	254.2	251.3	249.6	247.8	246.8	264.0	258.2
G25.0	264.3	260.8	256.4	253.5	250.5	248.8	247.1	246.1	263.2	257.4
G26.0	263.5	260.1	255.6	252.7	249.8	248.0	246.3	245.4	262.3	256.4
G27.0	262.5	259.1	254.7	251.8	248.9	247.1	245.4	244.4	261.4	255.5
G28.0	261.5	258.3	253.9	250.9	248.0	246.3	244.5	243.6	260.5	254.5
G29.0	260.6	257.3	252.9	250.0	247.1	245.3	243.6	242.6	259.4	253.5
G30.0	259.4	256.4	251.9	249.0	246.1	244.3	242.5	241.6	258.3	252.3
G31.0	258.4	255.3	250.9	248.0	245.0	243.4	241.6	240.6	257.3	251.2
G32.0	257.1	254.2	249.7	246.8	243.9	242.2	240.4	239.5	256.1	250.1
G33.0	255.9	253.1	248.7	245.7	242.8	241.2	239.4	238.4	255.0	248.8
G34.0	254.7	252.0	247.5	244.6	241.7	240.0	238.2	237.2	253.7	247.6
G35.0	253.4	250.7	246.2	243.4	240.3	238.8	236.9	236.0	252.4	246.2
G36.0	252.0	249.5	245.0	242.1	239.1	237.6	235.7	234.7	251.2	244.9

C Plane (°):0.0-360.0: 22.5  
 Test Lab:  
 Test Type: TYPE C  
 Temperature: 常温  
 Operator:

Gamma Plane (°):0.0-90.0:1.0  
 Test Device: GPM-1600L  
 Distance: 7.206 m  
 Humidity: 相对湿度65  
 Inspector:

## Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C22.5	C45.0	C67.5	C90.0	C112.5	C135.0	C157.5	C180.0	C202.5
G37.0	250.6	248.0	243.7	240.8	237.9	236.3	234.5	233.4	249.8	243.5
G38.0	249.1	246.8	242.3	239.4	236.6	234.9	233.1	232.2	248.3	242.0
G39.0	247.6	245.3	241.0	238.1	235.2	233.6	231.8	230.8	246.9	240.6
G40.0	246.0	243.8	239.5	236.6	233.7	232.1	230.3	229.4	245.3	239.0
G41.0	244.4	242.4	238.0	235.2	232.3	230.7	228.9	227.9	243.9	237.5
G42.0	242.9	240.8	236.6	233.7	230.9	229.3	227.5	226.4	242.3	235.9
G43.0	241.1	239.2	234.9	232.1	229.2	227.7	225.9	224.8	240.5	234.1
G44.0	239.4	237.6	233.4	230.6	227.7	226.2	224.4	223.3	239.0	232.5
G45.0	237.8	235.9	231.8	228.9	226.2	224.6	222.9	221.7	237.1	230.8
G46.0	235.8	234.2	230.0	227.2	224.4	223.0	221.1	220.1	235.5	229.0
G47.0	234.0	232.5	228.3	225.6	222.7	221.4	219.5	218.4	233.8	227.3
G48.0	232.0	230.6	226.4	223.8	220.9	219.5	217.7	216.6	231.9	225.3
G49.0	230.2	228.8	224.7	222.1	219.2	217.9	216.0	215.0	230.1	223.5
G50.0	228.2	227.1	222.9	220.3	217.5	216.2	214.4	213.3	228.3	221.7
G51.0	226.1	225.0	221.0	218.4	215.6	214.3	212.4	211.4	226.3	219.7
G52.0	224.2	223.2	219.1	216.6	213.7	212.5	210.7	209.7	224.4	217.8
G53.0	222.0	221.1	217.1	214.6	211.8	210.7	208.7	207.8	222.3	216.0
G54.0	220.0	219.1	215.1	212.7	209.9	208.8	206.9	205.9	220.3	213.8
G55.0	218.0	217.1	213.3	210.8	208.1	207.0	205.1	204.1	218.4	211.9
G56.0	215.7	215.0	211.1	208.7	206.0	204.9	203.1	202.2	216.3	209.6
G57.0	213.6	213.0	209.2	206.8	204.2	203.0	201.2	200.3	214.2	207.6
G58.0	211.5	210.7	207.2	204.7	202.2	200.9	199.3	198.2	212.1	205.6
G59.0	209.0	208.6	204.9	202.6	200.0	198.9	197.2	196.3	209.8	203.4
G60.0	206.9	206.5	202.9	200.6	198.1	197.1	195.2	194.3	207.8	201.2
G61.0	204.5	204.2	200.5	198.4	195.8	194.8	193.0	192.2	205.4	199.1
G62.0	202.3	202.0	198.5	196.3	193.8	192.9	190.9	190.1	203.3	196.8
G63.0	200.1	199.9	196.4	194.2	191.7	190.8	189.0	188.1	201.2	194.6
G64.0	197.5	197.5	194.0	191.9	189.5	188.6	186.7	185.9	198.8	192.3
G65.0	195.3	195.2	191.8	189.8	187.4	186.5	184.7	183.8	196.5	190.0
G66.0	193.0	192.8	189.7	187.4	185.2	184.2	182.7	181.5	194.3	187.8
G67.0	190.5	190.6	187.3	185.2	183.0	182.1	180.3	179.4	191.8	185.3
G68.0	188.1	188.3	185.0	183.0	180.8	179.9	178.2	177.3	189.6	183.1
G69.0	185.5	185.7	182.6	180.7	178.4	177.7	176.0	175.0	187.2	180.8
G70.0	183.2	183.5	180.3	178.5	176.2	175.5	173.8	172.8	184.8	178.4
G71.0	180.8	181.1	178.1	176.2	174.1	173.4	171.7	170.6	182.6	176.1
G72.0	178.3	178.6	175.6	173.7	171.6	171.1	169.3	168.3	180.0	173.6
G73.0	175.8	176.3	173.3	171.5	169.5	168.8	167.1	166.1	177.8	171.4

C Plane (°):0.0-360.0: 22.5  
 Test Lab:  
 Test Type: TYPE C  
 Temperature: 常温  
 Operator:

Gamma Plane (°):0.0-90.0:1.0  
 Test Device: GPM-1600L  
 Distance: 7.206 m  
 Humidity: 相对湿度65  
 Inspector:



## Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C22.5	C45.0	C67.5	C90.0	C112.5	C135.0	C157.5	C180.0	C202.5
G74.0	173.4	173.7	171.0	169.1	167.2	166.5	165.0	163.8	175.4	169.1
G75.0	170.7	171.3	168.5	166.8	164.8	164.3	162.6	161.6	172.9	166.6
G76.0	168.4	169.0	166.2	164.5	162.6	162.0	160.5	159.5	170.5	164.2
G77.0	165.6	166.4	163.6	162.1	160.1	159.6	158.1	157.1	167.9	161.9
G78.0	163.2	164.1	161.4	159.8	157.8	157.4	155.8	154.9	165.6	159.4
G79.0	160.8	161.6	159.0	157.6	155.6	155.2	153.6	152.7	163.3	157.1
G80.0	158.1	159.0	156.5	155.0	153.2	152.7	151.2	150.3	160.6	154.5
G81.0	155.7	156.7	154.1	152.8	150.9	150.5	149.0	148.1	158.3	152.2
G82.0	153.2	154.1	151.9	150.3	148.6	148.1	146.8	145.7	155.9	149.8
G83.0	150.5	151.7	149.2	148.0	146.1	145.9	144.3	143.5	153.4	147.4
G84.0	148.2	149.3	146.8	145.6	143.8	143.6	142.1	141.2	151.0	144.9
G85.0	145.4	146.7	144.4	143.1	141.4	141.2	139.8	138.9	148.5	142.4
G86.0	143.0	144.4	141.9	140.9	139.1	139.0	137.5	136.7	146.1	140.0
G87.0	140.6	142.0	139.6	138.6	136.9	136.7	135.3	134.5	143.9	137.7
G88.0	137.9	139.4	137.0	136.2	134.3	134.4	132.8	132.1	141.3	135.1
G89.0	135.4	137.1	134.7	133.9	132.0	132.1	130.6	130.0	139.0	132.8
G90.0	132.9	134.5	132.3	131.4	129.7	129.7	128.3	127.6	136.4	130.4

C Plane (°):0.0-360.0: 22.5  
 Test Lab:  
 Test Type: TYPE C  
 Temperature: 常温  
 Operator:

Gamma Plane (°):0.0-90.0:1.0  
 Test Device: GPM-1600L  
 Distance: 7.206 m  
 Humidity: 相对湿度65  
 Inspector:

## Candlepower Table (Continue 3)

Unit: cd

G\C	C225.0	C247.5	C270.0	C292.5	C315.0	C337.5	C360.0			
G0.0	263.6	260.9	258.8	257.1	255.8	254.8	272.3			
G1.0	263.6	260.9	258.9	257.1	255.9	254.7	272.3			
G2.0	263.6	260.9	258.8	257.1	255.9	254.8	272.3			
G3.0	263.5	260.8	258.8	257.0	255.9	254.8	272.3			
G4.0	263.4	260.8	258.8	257.0	255.9	254.7	272.3			
G5.0	263.2	260.7	258.7	256.9	255.8	254.8	272.3			
G6.0	263.1	260.5	258.6	256.9	255.8	254.7	272.2			
G7.0	263.0	260.4	258.4	256.8	255.7	254.6	272.2			
G8.0	262.8	260.2	258.3	256.6	255.6	254.6	272.0			
G9.0	262.6	260.0	258.1	256.5	255.4	254.4	271.9			
G10.0	262.4	259.8	257.9	256.4	255.3	254.3	271.7			
G11.0	262.1	259.5	257.7	256.1	255.1	254.1	271.6			
G12.0	261.8	259.2	257.5	255.8	254.9	253.9	271.3			
G13.0	261.5	258.9	257.2	255.6	254.6	253.7	271.0			
G14.0	261.1	258.5	256.9	255.2	254.2	253.3	270.7			
G15.0	260.7	258.1	256.5	254.9	254.0	253.0	270.4			
G16.0	260.3	257.7	256.0	254.5	253.5	252.7	269.9			
G17.0	259.8	257.2	255.6	254.0	253.1	252.2	269.6			
G18.0	259.3	256.7	255.1	253.5	252.7	251.8	269.1			
G19.0	258.7	256.1	254.5	252.9	252.1	251.3	268.5			
G20.0	258.1	255.6	254.0	252.4	251.6	250.7	268.0			
G21.0	257.5	254.9	253.4	251.8	251.0	250.1	267.3			
G22.0	256.8	254.2	252.6	251.0	250.3	249.4	266.7			
G23.0	256.1	253.5	252.0	250.3	249.6	248.8	265.9			
G24.0	255.2	252.7	251.1	249.5	248.8	248.1	265.1			
G25.0	254.4	251.8	250.3	248.6	248.1	247.3	264.3			
G26.0	253.5	250.9	249.5	247.8	247.2	246.5	263.5			
G27.0	252.5	250.0	248.5	246.8	246.3	245.6	262.5			
G28.0	251.6	249.0	247.6	245.9	245.4	244.7	261.5			
G29.0	250.6	248.0	246.5	244.9	244.4	243.7	260.6			
G30.0	249.4	246.9	245.4	243.8	243.4	242.6	259.4			
G31.0	248.4	245.8	244.4	242.7	242.3	241.6	258.4			
G32.0	247.2	244.7	243.2	241.6	241.1	240.6	257.1			
G33.0	246.0	243.4	242.0	240.4	239.9	239.4	255.9			
G34.0	244.8	242.3	240.8	239.2	238.8	238.2	254.7			
G35.0	243.4	240.9	239.4	237.8	237.4	236.9	253.4			
G36.0	242.1	239.6	238.2	236.5	236.2	235.7	252.0			

C Plane (°):0.0-360.0: 22.5  
 Test Lab:  
 Test Type: TYPE C  
 Temperature: 常温  
 Operator:

Gamma Plane (°):0.0-90.0:1.0  
 Test Device: GPM-1600L  
 Distance: 7.206 m  
 Humidity: 相对湿度65  
 Inspector:

## Candlepower Table (Continue 4)

Unit: cd

G\C	C225.0	C247.5	C270.0	C292.5	C315.0	C337.5	C360.0			
G37.0	240.8	238.3	236.9	235.2	234.9	234.4	250.6			
G38.0	239.3	236.8	235.4	233.6	233.5	233.0	249.1			
G39.0	237.9	235.4	234.0	232.2	232.0	231.6	247.6			
G40.0	236.3	233.8	232.4	230.7	230.4	230.1	246.0			
G41.0	234.8	232.3	230.9	229.2	229.0	228.6	244.4			
G42.0	233.3	230.8	229.4	227.6	227.5	227.1	242.9			
G43.0	231.5	229.1	227.6	225.9	225.8	225.4	241.1			
G44.0	229.9	227.4	226.0	224.3	224.2	223.8	239.4			
G45.0	228.1	225.8	224.2	222.7	222.5	222.3	237.8			
G46.0	226.4	223.9	222.5	220.8	220.8	220.4	235.8			
G47.0	224.7	222.2	220.8	219.2	219.1	218.8	234.0			
G48.0	222.8	220.3	218.9	217.3	217.2	216.9	232.0			
G49.0	221.0	218.6	217.2	215.5	215.4	215.2	230.2			
G50.0	219.1	216.9	215.3	213.7	213.7	213.5	228.2			
G51.0	217.2	214.8	213.4	211.7	211.6	211.5	226.1			
G52.0	215.3	212.9	211.6	209.8	209.8	209.6	224.2			
G53.0	213.2	211.0	209.4	208.0	207.8	207.8	222.0			
G54.0	211.4	209.0	207.5	205.8	205.8	205.7	220.0			
G55.0	209.3	207.0	205.6	203.9	204.0	203.8	218.0			
G56.0	207.2	204.9	203.4	201.8	201.7	201.6	215.7			
G57.0	205.2	202.9	201.4	199.7	199.8	199.7	213.6			
G58.0	203.2	200.8	199.4	197.7	197.8	197.7	211.5			
G59.0	201.0	198.6	197.1	195.5	195.5	195.5	209.0			
G60.0	198.8	196.6	195.1	193.4	193.5	193.4	206.9			
G61.0	196.6	194.4	192.7	191.3	191.1	191.3	204.5			
G62.0	194.5	192.2	190.7	188.9	189.1	189.1	202.3			
G63.0	192.3	190.0	188.5	186.8	187.0	187.0	200.1			
G64.0	190.0	187.7	186.2	184.4	184.5	184.6	197.5			
G65.0	187.8	185.5	184.0	182.2	182.4	182.5	195.3			
G66.0	185.5	183.3	181.8	180.0	180.3	180.3	193.0			
G67.0	183.2	180.9	179.4	177.6	177.8	177.8	190.5			
G68.0	180.9	178.7	177.1	175.3	175.6	175.7	188.1			
G69.0	178.4	176.4	174.8	173.2	173.2	173.5	185.5			
G70.0	176.1	174.1	172.4	170.7	170.9	171.0	183.2			
G71.0	173.9	171.7	170.3	168.5	168.7	168.8	180.8			
G72.0	171.4	169.3	167.7	166.0	166.3	166.4	178.3			
G73.0	169.2	167.0	165.5	163.7	164.1	164.1	175.8			

C Plane (°):0.0-360.0: 22.5  
 Test Lab:  
 Test Type: TYPE C  
 Temperature: 常温  
 Operator:

Gamma Plane (°):0.0-90.0:1.0  
 Test Device: GPM-1600L  
 Distance: 7.206 m  
 Humidity: 相对湿度65  
 Inspector:

## Candlepower Table (Continue 5)

Unit: cd

G\C	C225.0	C247.5	C270.0	C292.5	C315.0	C337.5	C360.0			
G74.0	167.0	164.7	163.3	161.5	161.7	161.9	173.4			
G75.0	164.4	162.2	160.8	158.9	159.2	159.4	170.7			
G76.0	162.1	160.0	158.5	156.7	157.1	157.1	168.4			
G77.0	159.5	157.7	155.9	154.3	154.5	154.8	165.6			
G78.0	157.3	155.1	153.7	151.9	152.1	152.2	163.2			
G79.0	155.0	152.8	151.4	149.5	149.9	150.0	160.8			
G80.0	152.4	150.3	149.0	147.1	147.4	147.5	158.1			
G81.0	150.1	148.0	146.6	144.7	145.2	145.2	155.7			
G82.0	147.9	145.7	144.4	142.5	142.8	142.9	153.2			
G83.0	145.4	143.2	141.9	140.0	140.4	140.5	150.5			
G84.0	143.1	140.9	139.7	137.8	138.1	138.2	148.2			
G85.0	140.6	138.4	137.2	135.2	135.5	135.7	145.4			
G86.0	138.3	136.1	134.9	132.9	133.3	133.4	143.0			
G87.0	136.0	133.8	132.6	130.7	131.1	131.1	140.6			
G88.0	133.6	131.2	130.2	128.1	128.6	128.6	137.9			
G89.0	131.3	128.9	127.9	125.8	126.3	126.3	135.4			
G90.0	128.8	126.7	125.5	123.5	123.8	124.0	132.9			

C Plane (°):0.0-360.0: 22.5  
Test Lab:  
Test Type: TYPE C  
Temperature: 常温  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: GPM-1600L  
Distance: 7.206 m  
Humidity: 相对湿度65  
Inspector: